



Public Safety Committee Meeting

Law Enforcement Agenda

October 24, 2020



1. Personnel
2. Stats
3. Calls For Service Report

1. Personnel:

We hired three (3) non-certified officers who are scheduled to start the academy the 3rd of January 2020. We have lost 4 officers in the last month. Three (3) to Atoka and one (1) to Tipton County Sheriff's Office.

I promoted three (3) Lieutenants and three (3) Sergeants on November 14, 2020 to fill vacant positions within the department. Only one of these promotions had a direct effect on Patrol personnel.

	Personnel		
	Present	Vacant	Full Staff
Chief	1	0	1
Act. Asst. Lt.	1	0	1
Lieutenant	3	0	3
Sergeant	5	0	5
Corporal	0	0	0
Detectives	3	0	3
SRO's	1	1	2
Patrol Officer	15	9	24
Civilian	3	1	4
Total	32	11	43

2.

Stats	Offense Category ^	Previous Yr Qty	Current Yr Qty	Change
Sex Offenses, Forcible		2	2	0.0%
Robbery		2	0	-100.0%
Assault		10	13	30.0%
Domestic Offenses		7	7	0.0%
Weapon		2	0	-100.0%
Miscellaneous Reports		32	20	-37.5%
Counterfeiting/Forgery		10	2	-80.0%
Burglary		3	2	-33.3%
Fraud		1	21	2000.0%
Motor Vehicle Theft		2	1	-50.0%
Larceny/Theft		26	18	-30.8%
Embezzlement		1	0	-100.0%
Memo		72	92	27.8%
Vandalism		5	7	40.0%
Drug/Narcotic		2	10	400.0%
Pornography/Obscene Material		1	0	-100.0%
Homicide		3	1	-66.7%

Arrest Type v	Previous Yr Qty	Current Yr Qty	Change
Juvenile (Summoned/Cited)	5	14	180.0%
Adult (Taken Into Custody)	26	29	11.5%
Adult (Summoned/Cited)	36	22	-38.9%
Adult (On-View Arrest)	22	15	-31.8%

Ticket Type ^	Previous Yr Qty	Current Yr Qty	Change
Ordinance	0	4	400.0%
Parking	0	0	0.0%
Red Flex	0	0	0.0%
Tow	0	0	0.0%
Traffic	0	187	18700.0%
Traffic Charges	0	276	27600.0%
Warning	0	204	20400.0%

Crash Type ▼	Previous Yr Qty	Current Yr Qty	Change
Property damage (under \$400)	0	7	700.0%
Property damage (over \$400)	0	23	2300.0%
Injury possible	0	3	300.0%

Records found: 3

3. Total Calls For Service

CALL TOTALS FROM JANUARY 2020 TO DECEMBER 2020													
Agency	Jan.	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Actual Annual
Atoka PD	710	816	619	437	643	605	640	744	601	574			6389
Brighton PD	463	361	283	195	357	392	399	518	368	372			3708
Covington PD	990	816	826	668	924	930	985	954	986	972			9051
Mason PD	237	187	167	81	146	121	70	38	56	123			1226
Munford PD	894	899	737	364	839	888	780	784	761	813			7759
Tipton County SO	2689	2540	2124	1518	1663	1891	2420	2224	2160	2044			21273
MONTHLY LE TOTALS	5983	5619	4756	3263	4572	4827	5294	5262	4932	4898	0	0	49406
Atoka FD	85	97	94	80	83	100	124	110	87	87			947
Brighton FD	73	75	53	58	53	58	74	62	71	65			642
Charleston FD	2	5	7	9	7	9	6	6	5	9			65
Covington FD	245	203	205	160	217	239	298	261	228	255			2311
Garland FD	12	12	15	15	10	10	19	13	9	18			133
Giltedge FD	37	26	42	33	39	43	53	57	39	40			409
Mason FD	23	19	27	33	21	27	20	31	18	13			232
Munford FD	88	98	88	79	71	95	103	97	91	97			907
Quito FD	79	95	68	83	102	60	51	49	36	53			676
Tipton County FD	51	45	30	42	16	49	68	75	55	63			494
Three Star FD	33	25	17	25	30	34	41	47	36	51			339
MONTHLY FD TOTALS	728	700	646	617	649	724	857	808	675	751	0	0	7155
Medic One	633	626	606	491	577	651	791	809	687	718			6589
MONTHLY EMS TOTAL	633	626	606	491	577	651	791	809	687	718	0	0	6589
Percentage *	-	-5.4%	-13.5%	-27.2%	32.6%	7.0%	11.9%	-0.9%	-8.5%	1.2%			
MONTHLY TOTALS													
Law Enforcement	5983	5619	4756	3263	4572	4827	5294	5262	4932	4898	0	0	
Fire Dept.	728	700	646	617	649	724	857	808	675	751	0	0	
Ambulance	633	626	606	491	577	651	791	809	687	718	0	0	
ALL AGENCIES	7344	6945	6008	4371	5798	6202	6942	6879	6294	6367	0	0	63150



City of Covington

OFFICE OF THE FIRE CHIEF

P.O. Box 768

Covington, Tennessee 38019



Covington Fire Department

Report for November 24,2020

1. Community Events: Kroger donated 3 pallets of hand sanitizer, mask, and hand soap. These items were distributed to all Fire and Police agencies in our county.
2. Volunteer Hours: 51 hours worked by Volunteers in the month of October.
3. Run Report for Oct. 22nd – November 19th , 2020 attached. Total calls for 2020.
4. County coverage area collections: \$79,870.00
5. Ventilation System Update:
6. Asst. Chief Channell and Chief Griggs attended a Tennessee Fire Commission meeting October 27th in Collierville Tn. (Rulemaking work session)
7. Personnel report: Nick Varner Volunteer Firefighter to Firefighter, Driver Nick Tindall promoted to Lieutenant, and Firefighter Dwain Edwards promoted to fill the now vacant Drivers position. (Full staff)
8. Training: Matthew Gardiner and Lt. Ed Moss completed Rope Technician. Lt. Brad Dunavant and Nick Tindall completed structural collapse technician, Jeremy Channell completed week two of Fire Officer -4. Zack Cook, Nick Varner, Zach Moffett, and Andrew Owen attended Tennessee River Training Nov.7-8th
9. Chief Richard Griggs was elected to serve as the Vice President for the Tipton County Fire Chiefs Association.
10. Care Report-(Free Smoke Alarms) call (901)-476-2578 to schedule.
11. Volunteer Firefighters.

Covington Fire Department


Covington, TN

This report was generated on 11/20/2020 1:05:26 PM



Breakdown by Major Incident Types for Date Range

Zone(s): All Zones | Start Date: 10/22/2020 | End Date: 11/19/2020

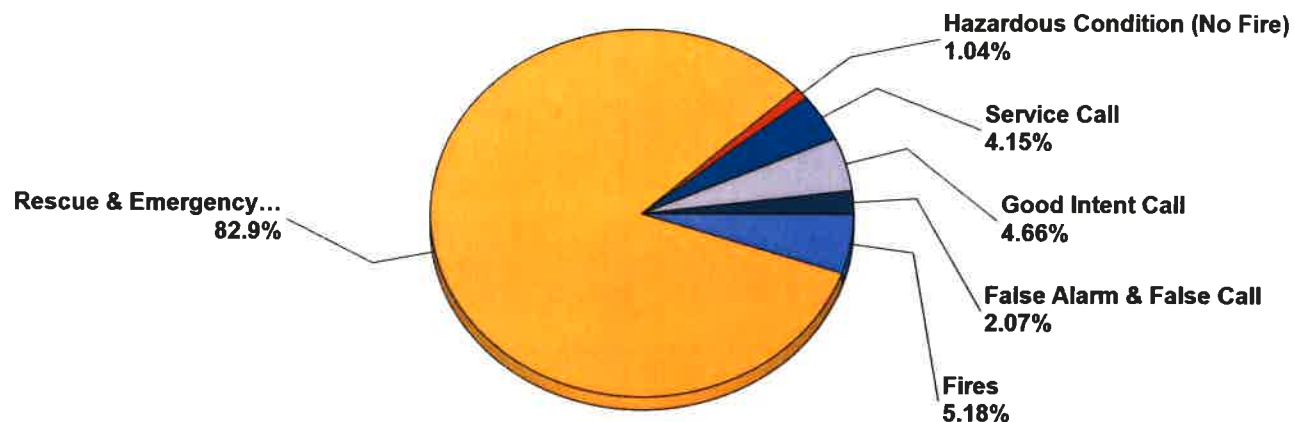

MAJOR INCIDENT TYPE	# INCIDENTS	% of TOTAL
Fires	10	5.18%
Rescue & Emergency Medical Service	160	82.9%
Hazardous Condition (No Fire)	2	1.04%
Service Call	8	4.15%
Good Intent Call	9	4.66%
False Alarm & False Call	4	2.07%
TOTAL	193	100%

Only REVIEWED and/or LOCKED IMPORTED incidents are included. Summary results for a major incident type are not displayed if the count is zero.



emergencyreporting.com

Doc Id: 553

Page # 1 of 2

Detailed Breakdown by Incident Type

INCIDENT TYPE	# INCIDENTS	% of TOTAL
111 - Building fire	6	3.11%
131 - Passenger vehicle fire	1	0.52%
140 - Natural vegetation fire, other	1	0.52%
151 - Outside rubbish, trash or waste fire	2	1.04%
311 - Medical assist, assist EMS crew	26	13.47%
321 - EMS call, excluding vehicle accident with injury	123	63.73%
322 - Motor vehicle accident with injuries	8	4.15%
324 - Motor vehicle accident with no injuries.	2	1.04%
331 - Lock-in (if lock out , use 511)	1	0.52%
424 - Carbon monoxide incident	1	0.52%
443 - Breakdown of light ballast	1	0.52%
510 - Person in distress, other	6	3.11%
551 - Assist police or other governmental agency	2	1.04%
611 - Dispatched & cancelled en route	9	4.66%
700 - False alarm or false call, other	1	0.52%
744 - Detector activation, no fire - unintentional	1	0.52%
745 - Alarm system activation, no fire - unintentional	2	1.04%
TOTAL INCIDENTS:	193	100%

Only REVIEWED and/or LOCKED IMPORTED incidents are included. Summary results for a major incident type are not displayed if the count is zero.



emergencyreporting.com

Doc Id: 553

Page # 2 of 2

Covington Fire Department


Covington, TN

This report was generated on 11/20/2020 1:06:15 PM



Breakdown by Major Incident Types for Date Range

Zone(s): All Zones | Start Date: 01/01/2020 | End Date: 12/31/2020

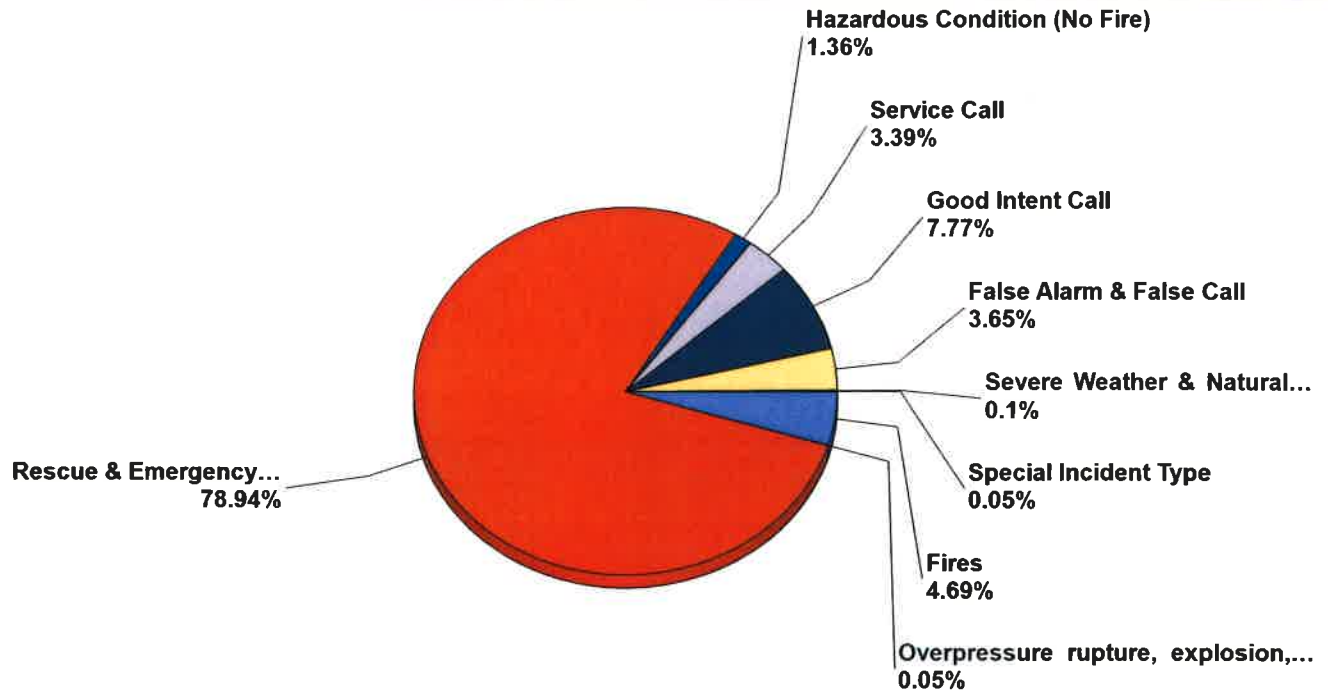

MAJOR INCIDENT TYPE	# INCIDENTS	% of TOTAL
Fires	90	4.69%
Overpressure rupture, explosion, overheating - no fire	1	0.05%
Rescue & Emergency Medical Service	1514	78.94%
Hazardous Condition (No Fire)	26	1.36%
Service Call	65	3.39%
Good Intent Call	149	7.77%
False Alarm & False Call	70	3.65%
Severe Weather & Natural Disaster	2	0.1%
Special Incident Type	1	0.05%
TOTAL	1918	100%

Only REVIEWED and/or LOCKED IMPORTED incidents are included. Summary results for a major incident type are not displayed if the count is zero.



emergencyreporting.com

Doc Id: 553

Page # 1 of 3

Detailed Breakdown by Incident Type

INCIDENT TYPE	# INCIDENTS	% of TOTAL
111 - Building fire	26	1.36%
112 - Fires in structure other than in a building	1	0.05%
113 - Cooking fire, confined to container	8	0.42%
117 - Commercial Compactor fire, confined to rubbish	1	0.05%
118 - Trash or rubbish fire, contained	4	0.21%
123 - Fire in portable building, fixed location	1	0.05%
131 - Passenger vehicle fire	10	0.52%
132 - Road freight or transport vehicle fire	1	0.05%
140 - Natural vegetation fire, other	2	0.1%
142 - Brush or brush-and-grass mixture fire	8	0.42%
143 - Grass fire	20	1.04%
151 - Outside rubbish, trash or waste fire	3	0.16%
153 - Construction or demolition landfill fire	1	0.05%
154 - Dumpster or other outside trash receptacle fire	2	0.1%
162 - Outside equipment fire	1	0.05%
171 - Cultivated grain or crop fire	1	0.05%
251 - Excessive heat, scorch burns with no ignition	1	0.05%
300 - Rescue, EMS incident, other	1	0.05%
311 - Medical assist, assist EMS crew	372	19.4%
320 - Emergency medical service, other	7	0.36%
321 - EMS call, excluding vehicle accident with injury	1048	54.64%
322 - Motor vehicle accident with injuries	49	2.55%
323 - Motor vehicle/pedestrian accident (MV Ped)	7	0.36%
324 - Motor vehicle accident with no injuries.	21	1.09%
331 - Lock-in (if lock out , use 511)	4	0.21%
352 - Extrication of victim(s) from vehicle	3	0.16%
357 - Extrication of victim(s) from machinery	1	0.05%
361 - Swimming/recreational water areas rescue	1	0.05%
411 - Gasoline or other flammable liquid spill	1	0.05%
412 - Gas leak (natural gas or LPG)	5	0.26%
413 - Oil or other combustible liquid spill	1	0.05%
421 - Chemical hazard (no spill or leak)	1	0.05%
424 - Carbon monoxide incident	2	0.1%
440 - Electrical wiring/equipment problem, other	1	0.05%
441 - Heat from short circuit (wiring), defective/worn	1	0.05%
442 - Overheated motor	2	0.1%
443 - Breakdown of light ballast	1	0.05%
444 - Power line down	3	0.16%
445 - Arcing, shorted electrical equipment	2	0.1%
461 - Building or structure weakened or collapsed	5	0.26%
463 - Vehicle accident, general cleanup	1	0.05%
500 - Service Call, other	2	0.1%
510 - Person in distress, other	36	1.88%
511 - Lock-out	2	0.1%
512 - Ring or jewelry removal	1	0.05%
520 - Water problem, other	1	0.05%
522 - Water or steam leak	1	0.05%
531 - Smoke or odor removal	2	0.1%
551 - Assist police or other governmental agency	11	0.57%
552 - Police matter	1	0.05%
554 - Assist invalid	6	0.31%
561 - Unauthorized burning	2	0.1%
600 - Good intent call, other	3	0.16%
611 - Dispatched & cancelled en route	126	6.57%
622 - No incident found on arrival at dispatch address	9	0.47%

Only REVIEWED and/or LOCKED IMPORTED incidents are included. Summary results for a major incident type are not displayed if the count is zero.



emergencyreporting.com

Doc Id: 553

Page # 2 of 3

Detailed Breakdown by Incident Type

INCIDENT TYPE	# INCIDENTS	% of TOTAL
650 - Steam, other gas mistaken for smoke, other	1	0.05%
651 - Smoke scare, odor of smoke	8	0.42%
652 - Steam, vapor, fog or dust thought to be smoke	1	0.05%
671 - HazMat release investigation w/no HazMat	1	0.05%
700 - False alarm or false call, other	13	0.68%
710 - Malicious, mischievous false call, other	1	0.05%
711 - Municipal alarm system, malicious false alarm	2	0.1%
715 - Local alarm system, malicious false alarm	3	0.16%
730 - System malfunction, other	2	0.1%
731 - Sprinkler activation due to malfunction	1	0.05%
733 - Smoke detector activation due to malfunction	11	0.57%
734 - Heat detector activation due to malfunction	2	0.1%
735 - Alarm system sounded due to malfunction	8	0.42%
741 - Sprinkler activation, no fire - unintentional	1	0.05%
743 - Smoke detector activation, no fire - unintentional	13	0.68%
744 - Detector activation, no fire - unintentional	3	0.16%
745 - Alarm system activation, no fire - unintentional	10	0.52%
813 - Wind storm, tornado/hurricane assessment	2	0.1%
911 - Citizen complaint	1	0.05%
TOTAL INCIDENTS:	1918	100%


Only REVIEWED and/or LOCKED IMPORTED incidents are included. Summary results for a major incident type are not displayed if the count is zero.



emergencyreporting.com


Doc Id: 553

Page # 3 of 3

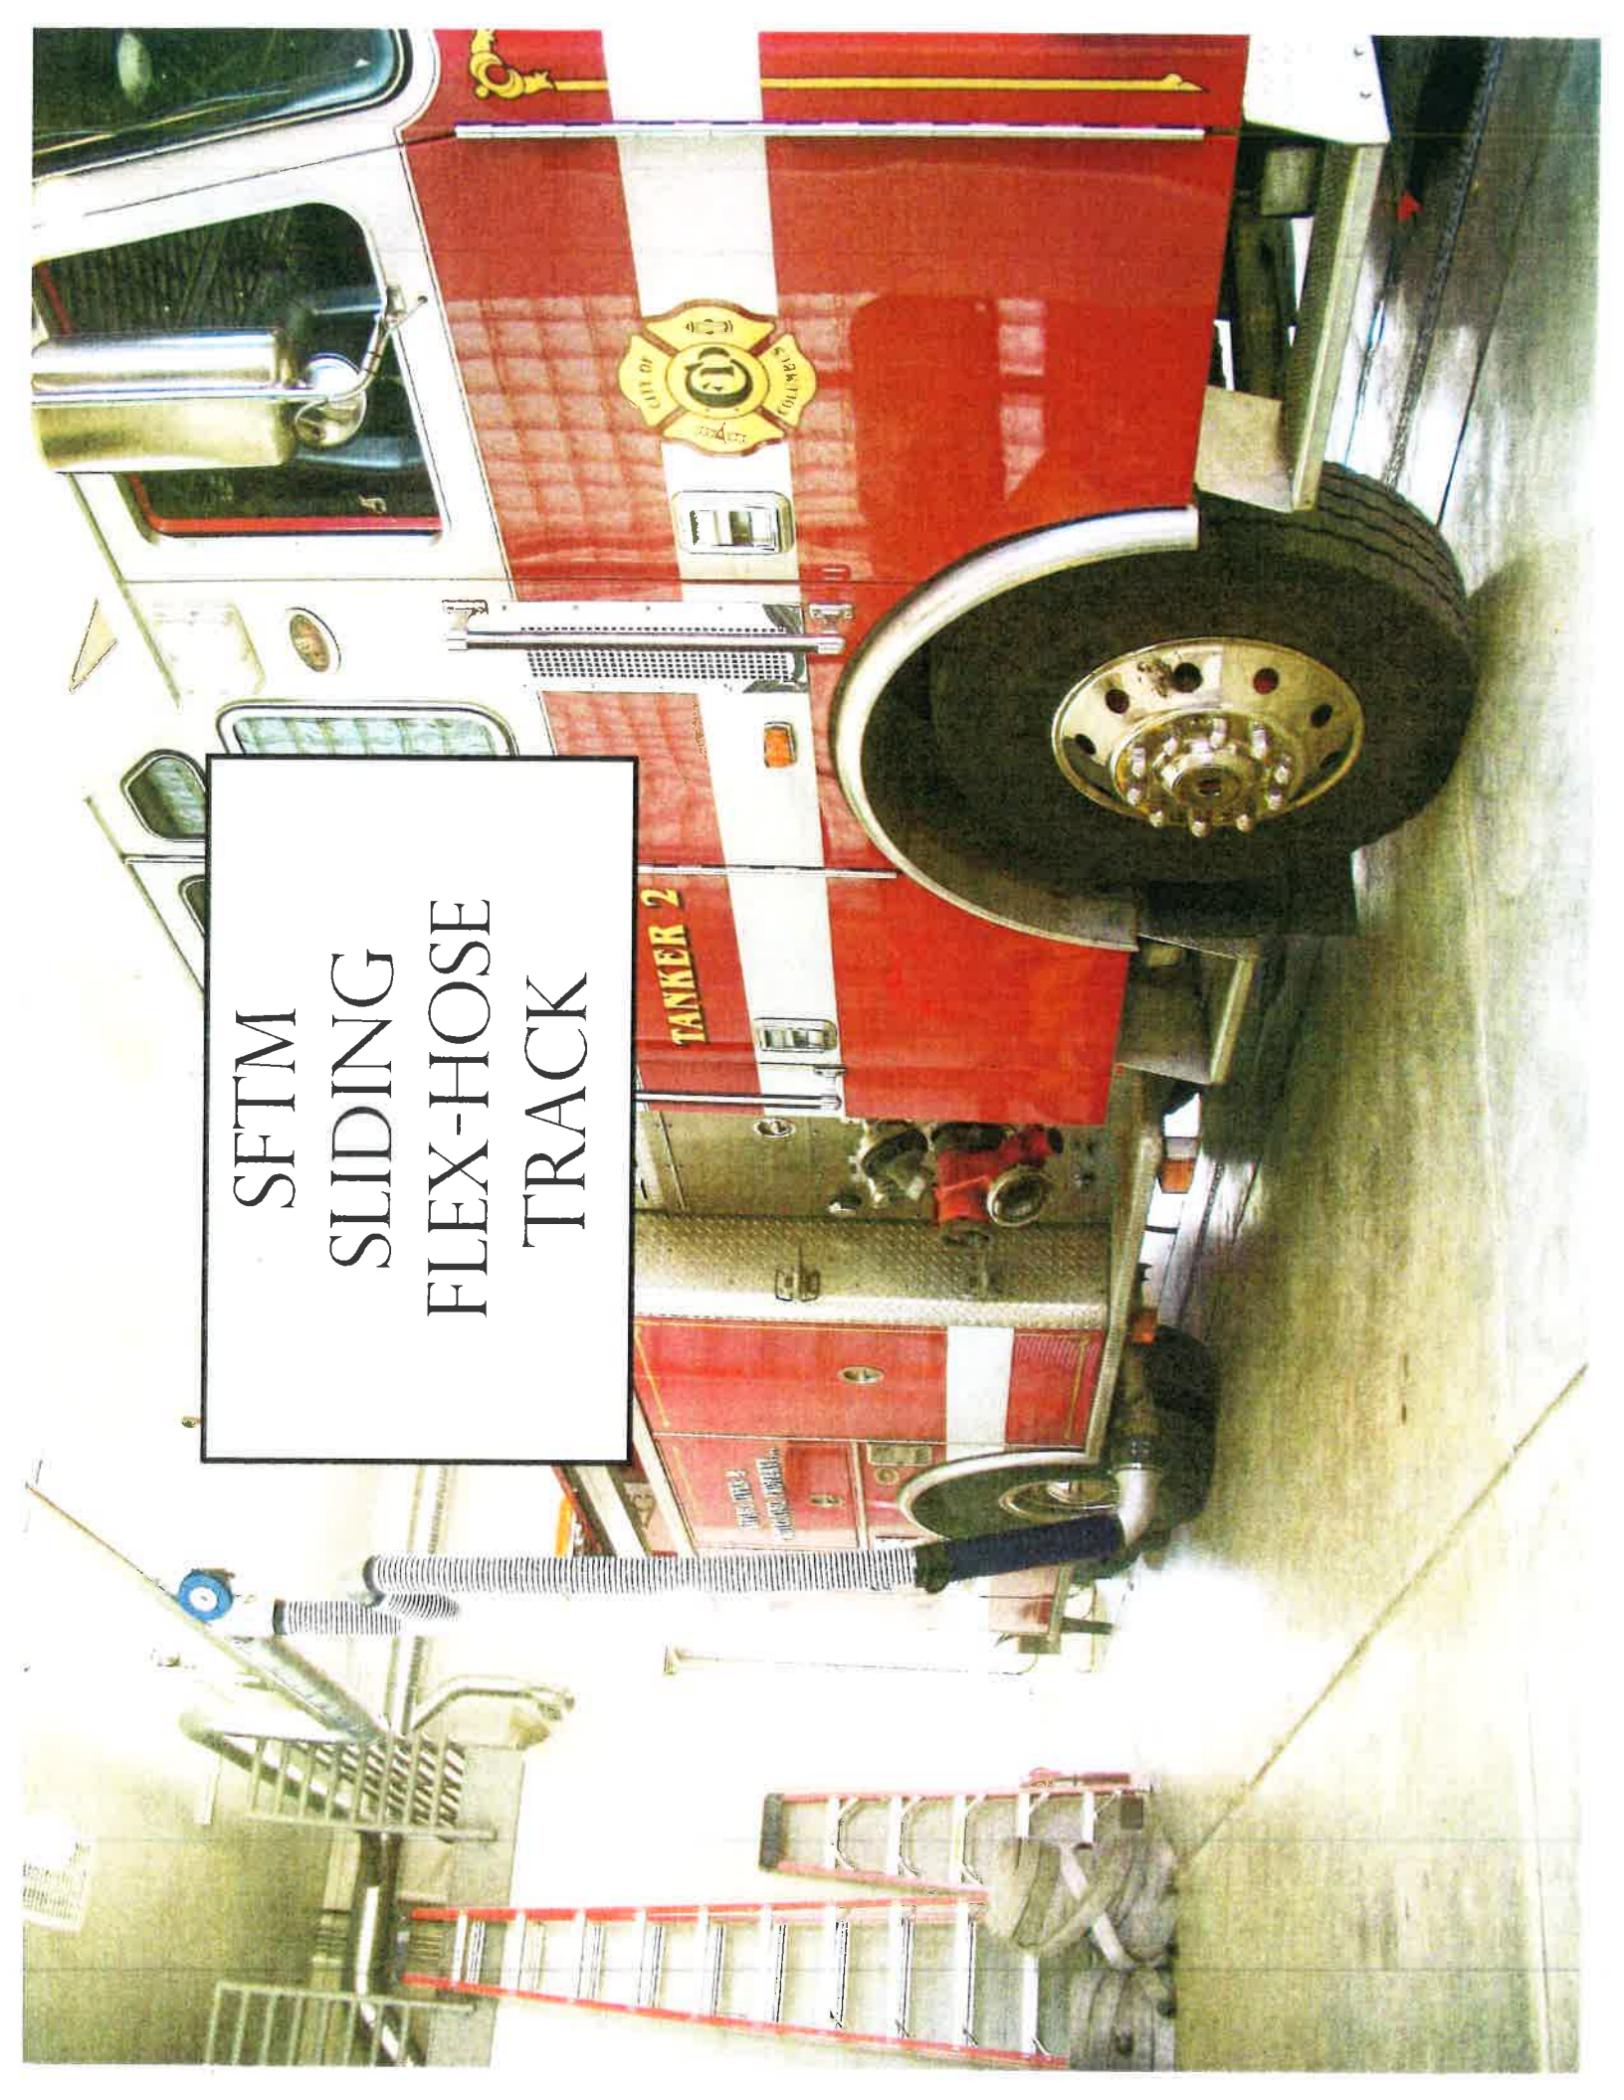

SFTM
SLIDING
FLEX-HOSE
TRACK


HIGH TEMP LOWER HOSE

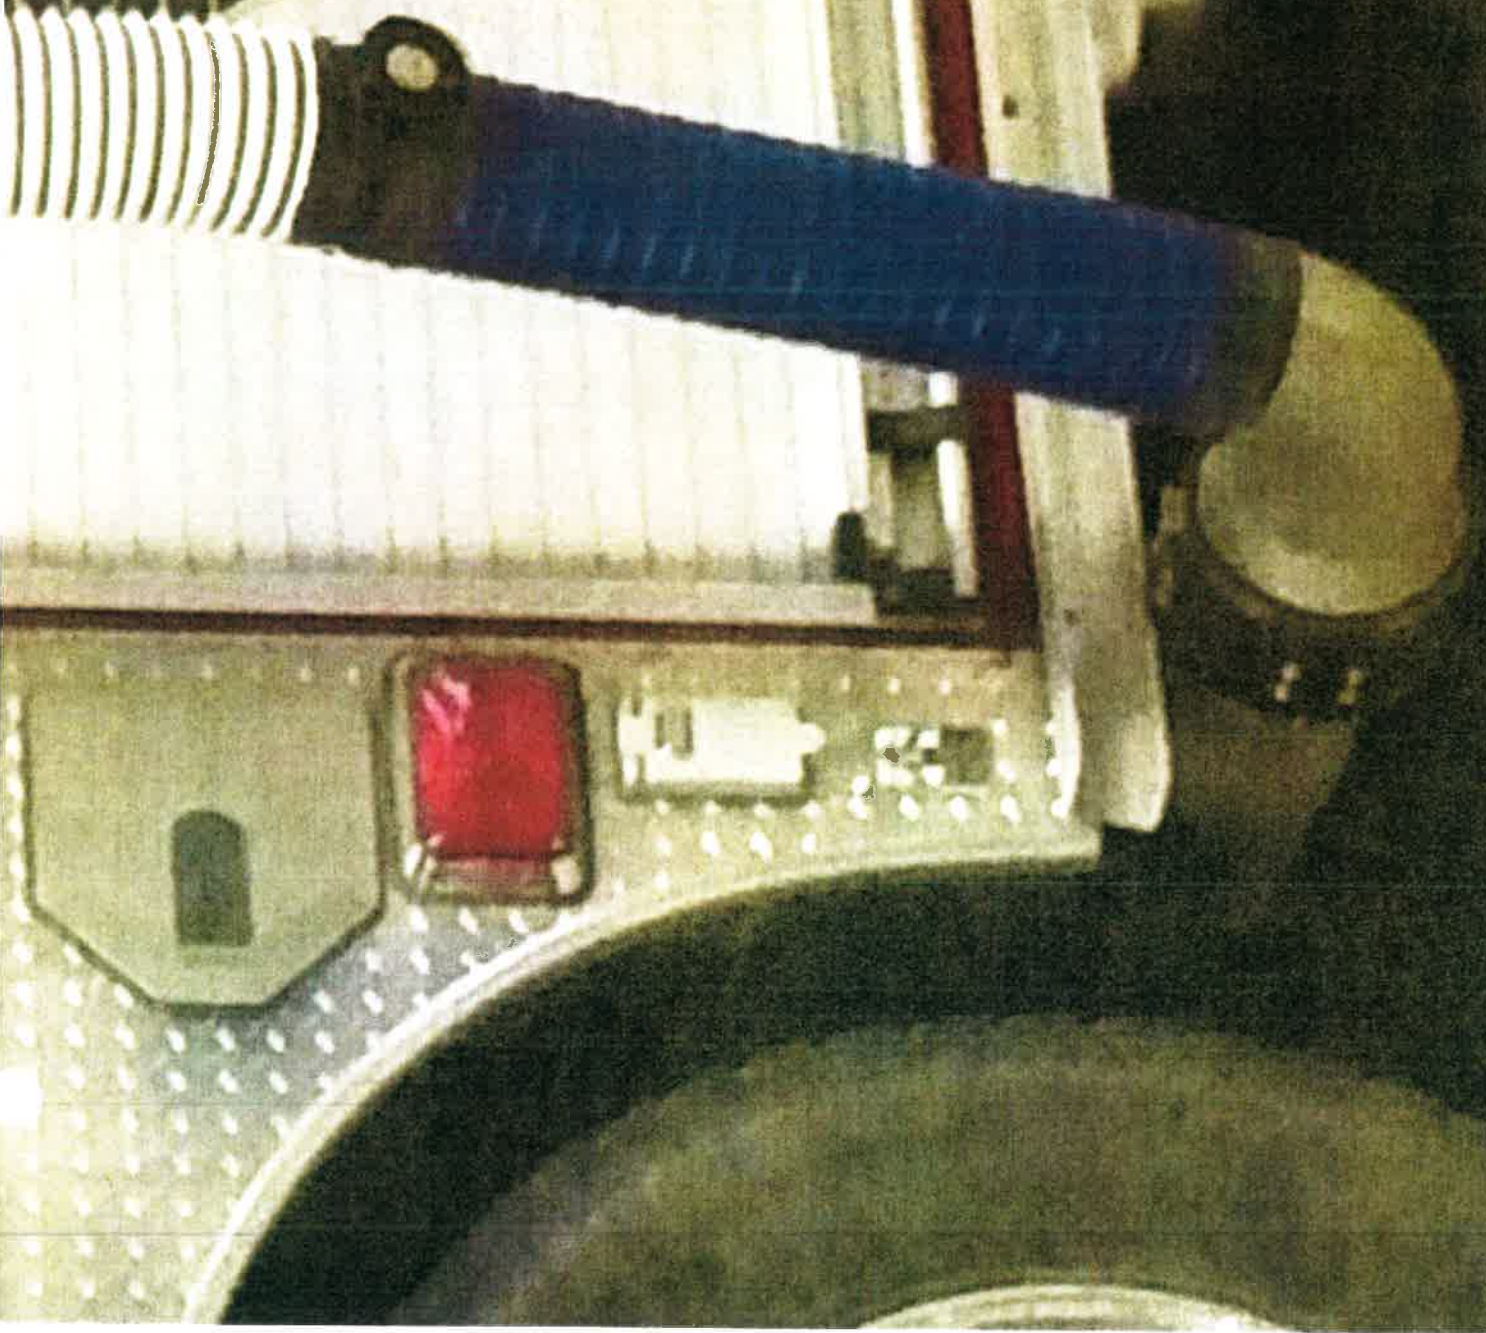

ONLY
MAGNETIC
NOZZLE
THAT SEALS
100%



CHECK VALVE
CREATES
POSITIVE SEAL

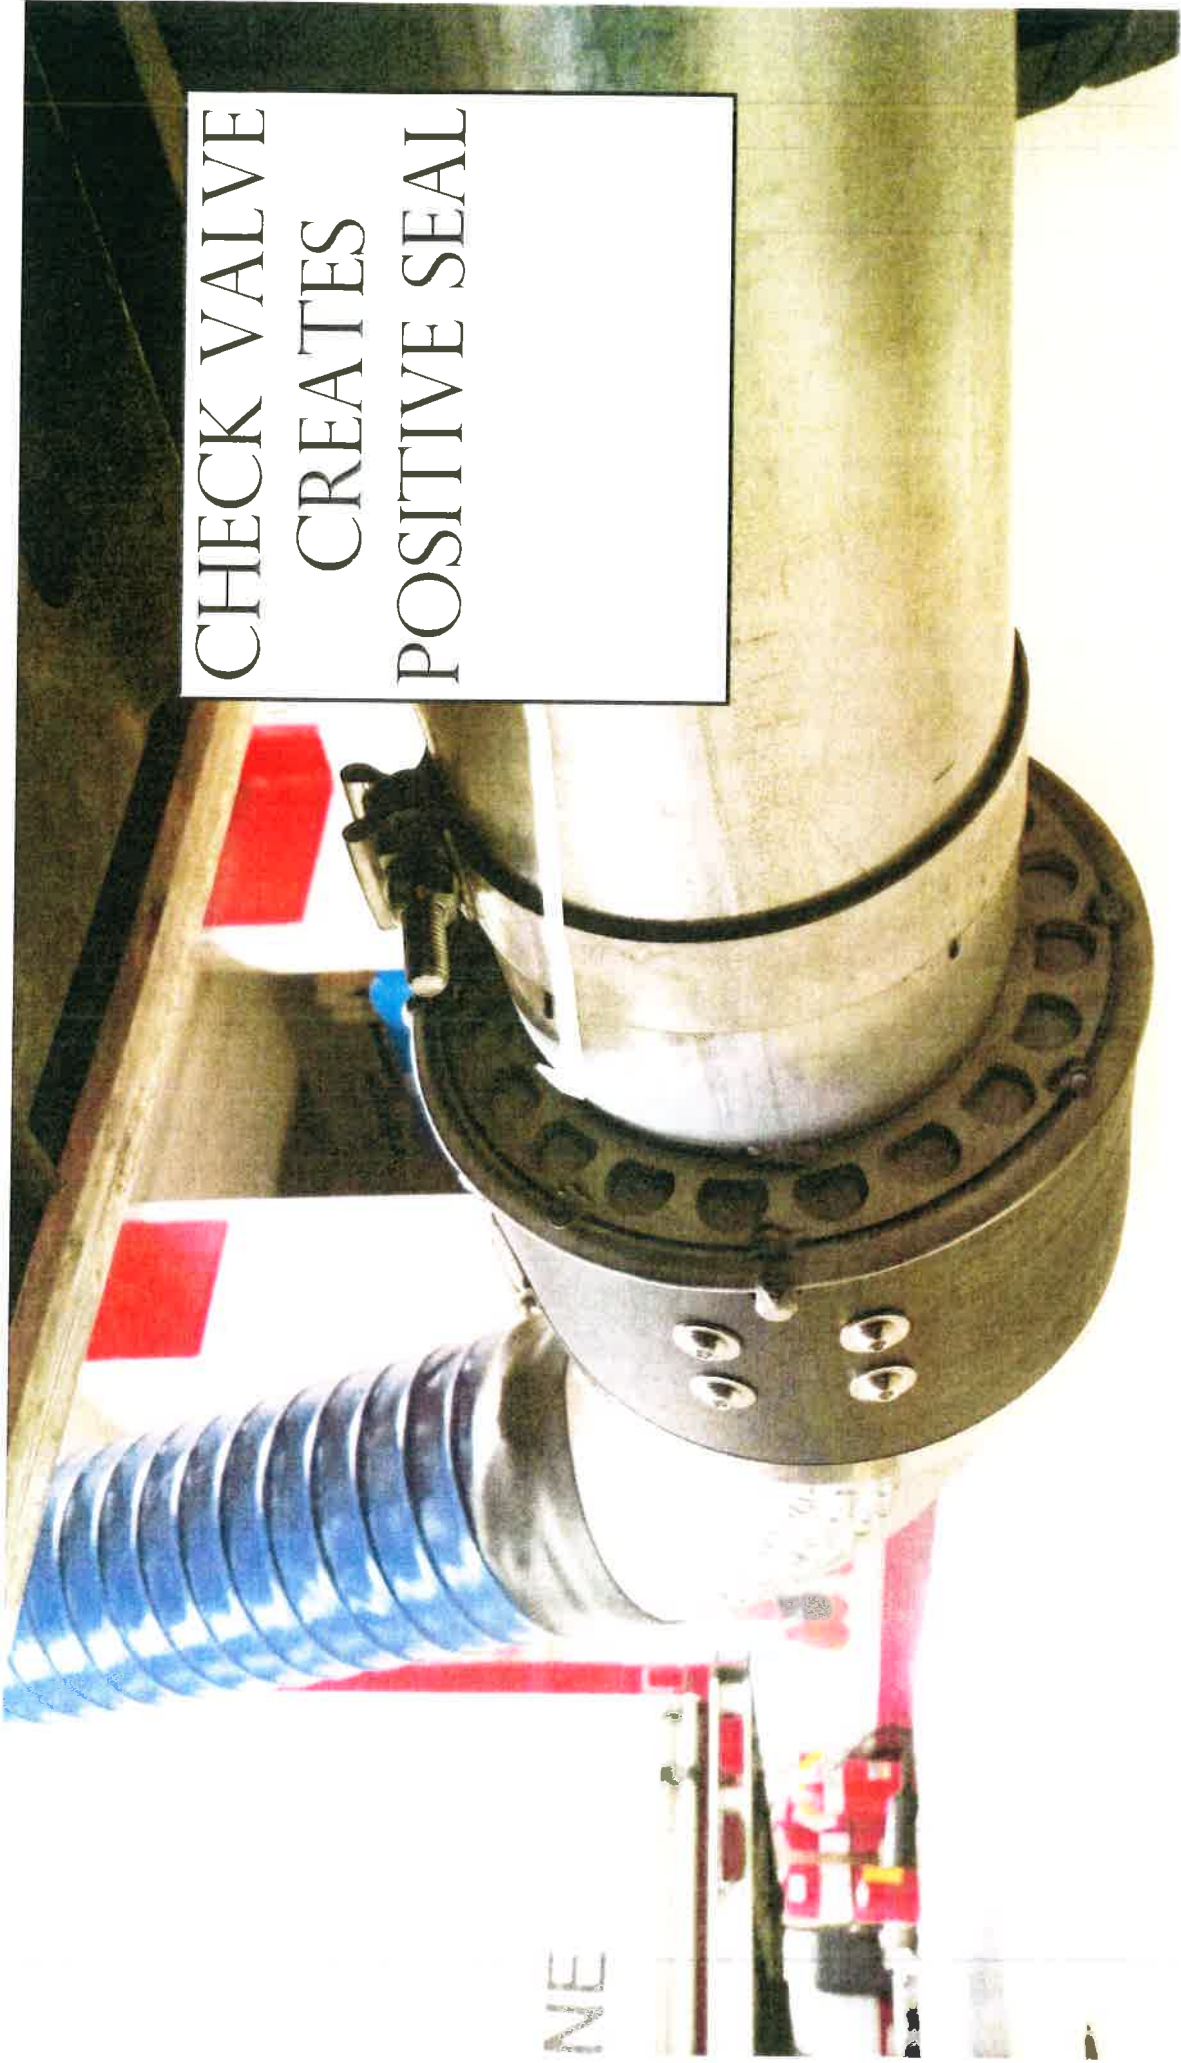



A DIVISION OF CLEAN AIR CONCEPTS

DATE: November 17, 2020

PROPOSAL FOR: City of Covington
100 West Washington
Covington, Tennessee 38019

ATTENTION: Purchasing Department

REF: City of Covington, Fire Department – "Diesel Vehicle Exhaust System Bid"

PROJECT SCOPE: Provide and Install a fully automatic MagneGrip® Diesel Exhaust Extraction System for removal of apparatus exhaust emissions from start up to door threshold.

EQUIPMENT, MATERIAL AND LABOR PRICE:

Station #1:

Six (6) Drops MagneGrip® Source Capture System

Note: Bay numbers shown below are as depicted on enclosed drawing.

Package Includes:

- Bay #1 F & R: (2) SFTM-361 36' Sliding Flex Hose Track MagneGrip® (No Loop)
- Bay #2 F & R: (2) SFTM-361 36' Sliding Flex Hose Track MagneGrip® (No Loop)
- Bay #3 F & R: (2) SFTM-361 36' Sliding Flex Hose Track MagneGrip® (No Loop)
- (1) CF363-7.5 MagneGrip® Exhaust Fan 7.5HP-3PH rated at 4400 CFM at 6" SP
- (1) 500181-08 Wireless Auto-Start Control Panel 7.5HP/208-230V/3PH
- (1) 500157-14 14" Up-blast Back Draft Damper Type Rain Cap
- (1) 510023-05 MagneGrip® 5" Vise Grip Nozzle

STATION #1 PRICE \$56,910.00

Station #2:

Six (6) Drops MagneGrip® Source Capture System

Note: Bay numbers shown below are as depicted on enclosed drawing.

Package Includes:

- Bay #1 F & R: (2) SFTM-361 36' Sliding Flex Hose Track MagneGrip® (No Loop)
- Bay #2 F & R: (2) SFTM-361 36' Sliding Flex Hose Track MagneGrip® (No Loop)
- Bay #3 F & R: (2) SFTM-361 36' Sliding Flex Hose Track MagneGrip® (No Loop)
- (1) CF363-7.5 MagneGrip® Exhaust Fan 7.5HP-3PH rated at 4400 CFM at 6" SP
- (1) 500181-08 Wireless Auto-Start Control Panel 7.5HP/208-230V/3PH
- (1) 500157-14 14" Up-blast Back Draft Damper Type Rain Cap
- (1) 510023-05 MagneGrip® 5" Vise Grip Nozzle

STATION #2 PRICE \$56,910.00



11449 Deerfield Road | Cincinnati, OH 45242 | 513-489-4440 | 800-875-5440 | Fax: 513-247-2502 | email: info@magnegrip.com

www.magnegrip.com



A DIVISION OF CLEAN AIR CONCEPTS

- Each Hose Assembly includes a 5" diameter high-temp upper hose section, a 850 degree extreme high-temp 2' lower hose section with handle, a nozzle that attaches to the tailpipe adaptor to contain 100% of exhaust emissions while providing ambient air to reduce exhaust temperatures, a tailpipe adaptor assembly that provides easy connection and cool air induction.
- UL/CUL Wireless Auto-Start Control Panel with NEMA 4X enclosure to provide auto start/stop operation with adjustable timer, manual override switch, and wireless capability.
- Electrical wiring from available supply to control panel and exhaust fan. Safety disconnect for fan motor. Subpanels are excluded, if required, and any modifications required to bring service to code are excluded.
- Each Hose Assembly is provided with a transmitter and pressure sensor for automatic system.
- Tailpipe Modifications as required but, limited to vehicle tailpipes from the muffler out. Rusted or Damaged Tailpipes are the responsibility of the Fire Department.
- Class 2 Spiral Duct, Fittings, and Hangers
- Adjustable Telescopic Support Legs to hang rail or track systems
- Shipping to Job Site
- Labor & Material to Install Systems-Penetration of Hanging Drywall Ceiling to secure legs and supports to building to install track or rail systems.
- Wall Penetration for Fan Discharge
- Start up and Training
- Equipment is 100% American Made by an ISO9001-2015 Company
- Women's Business Enterprise (WBE) Certified
- Women's Owned Small Business (WOSB) Certified

BASE SYSTEM PRICE.....\$113,820.00

Optional Items:

(9) AirHAWK® 265 Portable Air Filtration Units @\$700.00/Unit.....\$6,300.00

(18) AirHAWK® filter packs (2 bulbs and 1 of each filter) @ \$220.00/pack.....\$3,960.00

3 Year Preventative Maintenance Contract:

\$495.00/Station/Year for years 1,2 and

\$595.00/Station/Year for year 3.....\$3,170.00

GRAND TOTAL PRICE.....\$127,250.00



11449 Deerfield Road | Cincinnati, OH 45242 | 800-875-5440 | Fax: 513-247-2502 | email: info@magnetgrip.com

www.magnetgrip.com | WBE/WOSB Certified | Made in USA



A DIVISION OF CLEAN AIR CONCEPTS

TERMS:

- One MagneGrip® Tailpipe Adapter and installation is included with each MagneGrip® hose drop assembly for a total of twelve (12). All vehicles that require Tailpipe Adapters must be made available to CAC technicians at the time of system installation.
- Above pricing includes twelve (12) tailpipe adapters. For additional tailpipe adapters, please call your CAC representative for further information and pricing.
- Pricing does not include any state taxes, sales tax, or special tax if required.
- Upon receipt of order, please submit a signed copy of this proposal and a tax exemption certificate.
- Net Due upon completion of project.

DATE:

November 17, 2020

PROPOSAL FOR:

City of Covington
100 West Washington
Covington, Tennessee 38019

ATTENTION:

Purchasing Department

REF:

City of Covington, Fire Department – “Diesel Vehicle Exhaust System Bid”

GRAND TOTAL PRICE.....\$127,240.00

SUBMITTED BY:

Clean Air Concepts

Maggie Rossman-Roach, President

Date

ACCEPTED BY:

Company: _____

Print: _____

Sign: _____

Title: _____

Date: _____

PO #, If Required: _____



11449 Deerfield Road | Cincinnati, OH 45242 | 800-875-5440 | Fax: 513-247-2502 | email: info@magnetgrip.com

www.magnetgrip.com | WBE/WOSB Certified | Made in USA

PROJECT NO. —
SYSTEMS SLIDING FLEXHOSE TRACK
 ISO 9001:2015 CERTIFIED
 UNITS: INCHES

THIS DRAWING (VEHICLE EXHAUST SYSTEM) DESIGN IS THE SOLE PROPERTY OF CLEARVIEW CONCEPTS. IT IS NOT TO BE USED OR REPRODUCED WITHOUT THE PERMISSION OF THE DESIGNER. 1 AND 201 CALL

The Maguire Group
 Vehicle Exhaust Venting Systems



Galvin Air Concepts
 11445 GERRARD ROAD
 FARM (813) 267-2500
 ONLY (313) 884-4460

REVISIONS

PROJECT: DIESEL EXHAUST SYSTEM - FLOOR PLAN
 SHEET TITLE: DIESEL EXHAUST SYSTEM
 101 Tennessee Avenue
 Covington, TN 38019
 Covington Fire Station #1

DATE: 10/15/20
 SHEET NO.

FLUOR DAN DIESEL EXHAUST SYSTEM
 SCALE: NOT NECESSARY TO ANY SCALE
 FOR ILLUSTRATION PURPOSES ONLY
 made in USA

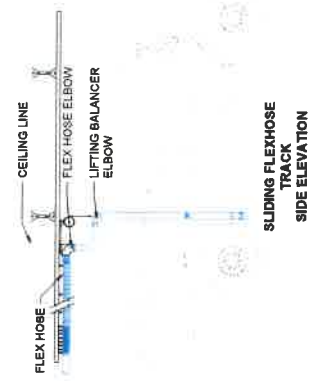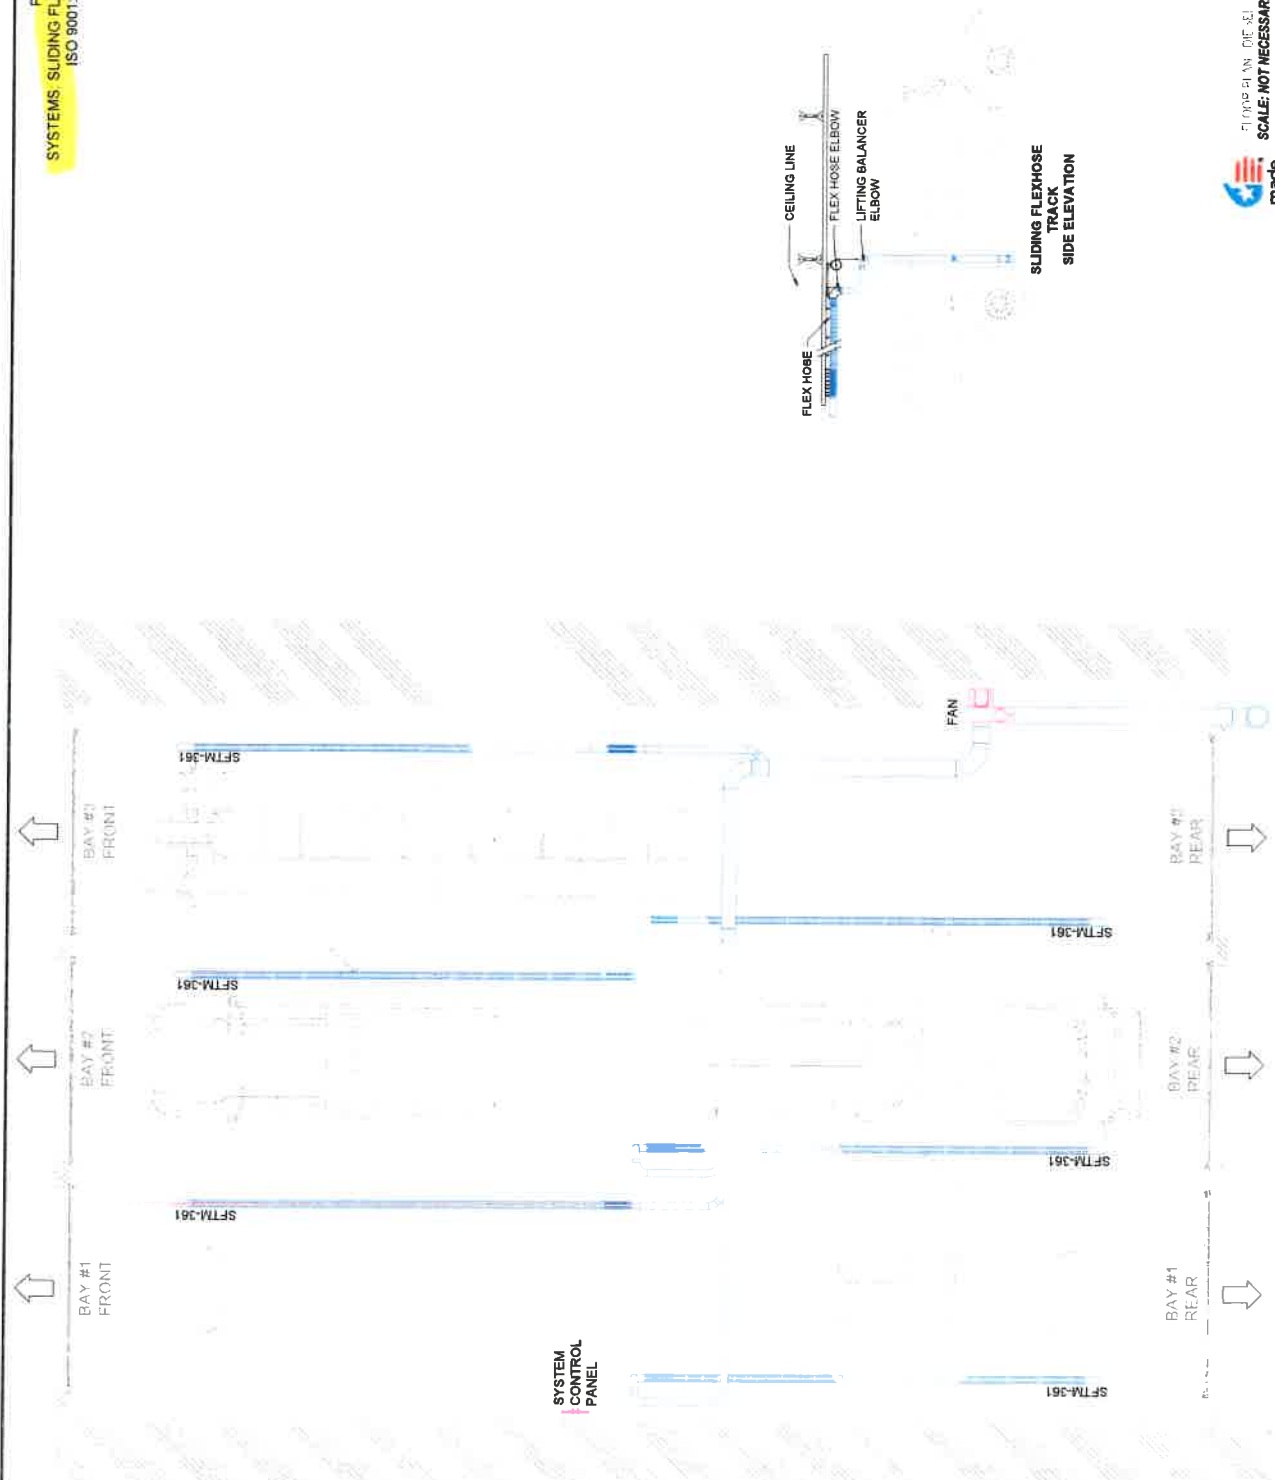

PROJECT NO: —
 SYSTEMS: SLIDING FLEXHOSE TRACK
 ISO 9001:2015 CERTIFIED
 UNITS: INCHES

THIS DRAWING (VEHICLE EXHAUST SYSTEM) DESIGN
 IS THE SOLE PROPERTY OF CLEAN AIR CONCEPTS. IT
 IS TO BE USED ONLY FOR THE PROJECT AND NOT BE
 REPRODUCED OR COPIED IN ANY MANNER WITHOUT THE WRITTEN
 PERMISSION OF THE DESIGNER. 1/2015 1/2015

The Maguire Group
 Vehicle Exhaust Venting Systems


Clean Air Concepts
 11419 GREENFIELD ROAD
 FARMINGTON, CT 06030
 (860) 671-1141
 OFFICE (860) 671-1141

REVISIONS

Covington Fire Station #2
 100 Mueller Brass Road
 Covington, TN 38019
 DIESEL EXHAUST SYSTEM - FLOOR PLAN

PROJECT:
 SHEET TITLE: DIESEL EXHAUST SYSTEM - FLOOR PLAN
 DATE: 10/15/20
 SHEET NO:
 DRN:
 CHG:
 CADD:
 EOR:
 DATE: 10/15/20
 SHEET NO:
 PROJECT:
 SHEET TITLE: DIESEL EXHAUST SYSTEM - FLOOR PLAN

SLIDING FLEXHOSE TRACK SYSTEM
 SCALE: NOT NECESSARILY TO ANY SCALE
 FOR ILLUSTRATION PURPOSES ONLY
 made in USA

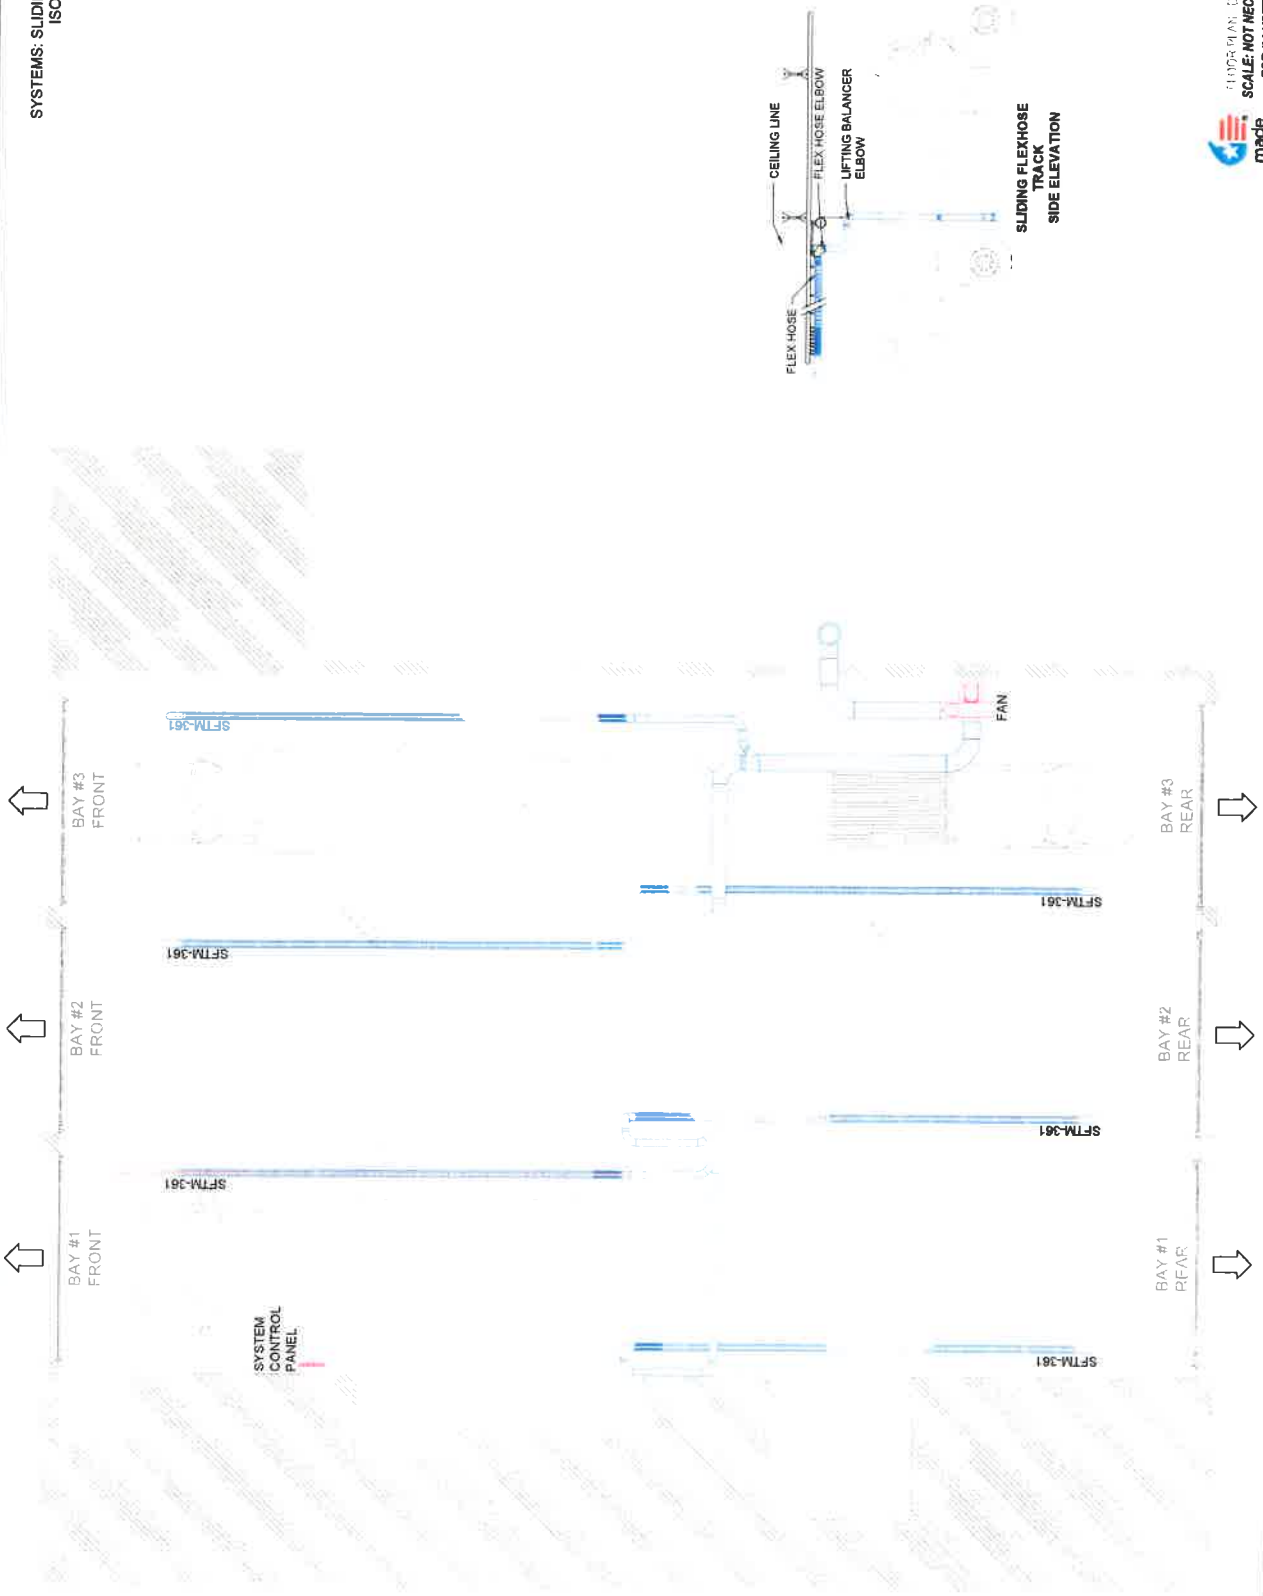

Covington Fire Dept. CARE/911 Alternative Program

Monthly Report – November, 2020

- General Office Duties
- October monthly Inspection of Fire equipment – Medical – my Infection Control Officer Duties, all equipment passed
- Completed One AHA BLS recertification class
- Completed two AHA Heart Saver 1st Aid CPR AED recertification classes
- Installed seventeen smoke Alarms
- Approximately twenty-five welfare checks
- Delivered at this time, approximately 3365 masks from the Tipton County Health Department to Churches and various citizen
- Two visits to Baptist Hospital Tipton Emergency Department